


**1** PART GROUND FLOOR PLAN  
S1 1:50

**GENERAL NOTES**

- FLOOR STRUCTURE IS EXISTING UNLESS NOTED OTHERWISE. EXISTING BUILDING IS DESIGNED BY JOHN F. ROSS ARCHITECT ON YEAR 1958.
- UNLESS NOTED OTHERWISE PROVIDE NEW 110mm SLAB ON GRADE AS PER SPECIFICATION THROUGHOUT AND AS PER 2/S1. SAWCUT SLAB INTO AREAS 6m x 6m MAX. PROVIDE CONTROL JOINTS IN ALL DOORWAYS. REINF. 1 LAYER 152 X 152 MW18.7/MW18.7 WWF OR USING FIBRE MESH. REFER TO 'NEW SLAB ON GRADE' DETAIL ON THIS DRAWING.
- USE DETAIL 3/S1 AT ALL LOCATIONS WHERE EXISTING SLAB IS TO BE CUT AND REPAIRED AND FOR ALL NEW BELOW GRADE SERVICES.
- SHORE AS REQUIRED.

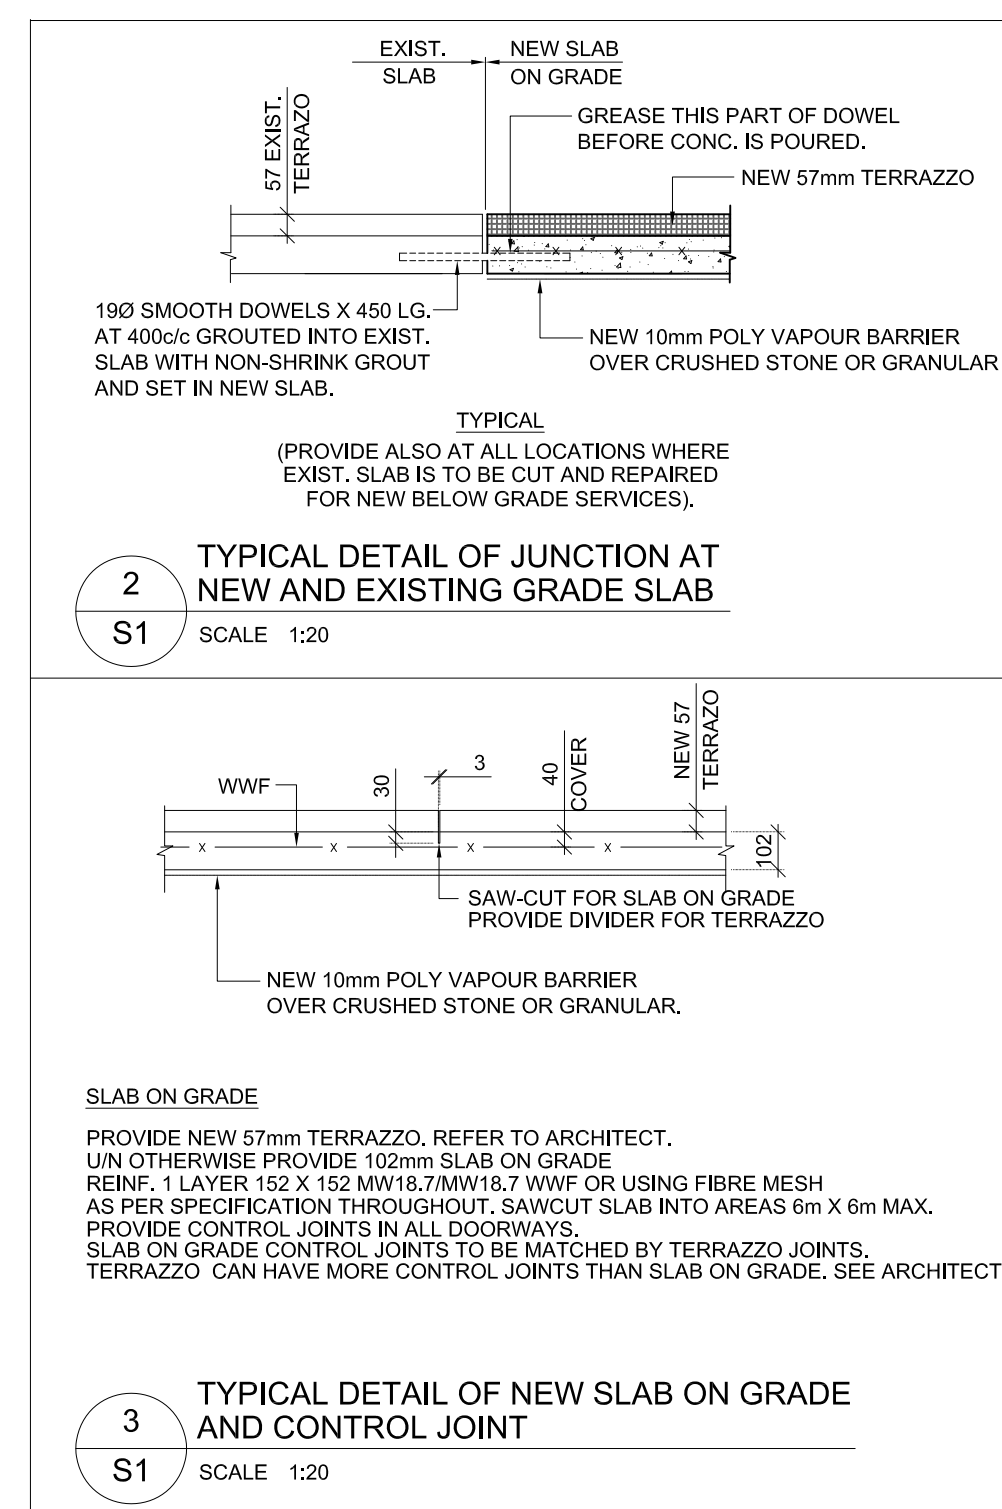

**VX**  
VX ENGINEERING INC  
STRUCTURAL ENGINEERS

VX ENGINEERING inc.  
2500 - 135 Marlee Avenue  
Toronto, Ontario M6B 4C6  
416 670 9422 www.vxengineering.com

NOTE: THIS DRAWING IS NOT TO BE SCALED. THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF ALL SITE DIMENSIONS AND FOR NOTIFYING THE ARCHITECT OF ANY SITE CONDITIONS AND SITE MEASUREMENTS THAT ARE NOT CONSISTENT WITH THE DRAWINGS.

| no. | revision | date |
|-----|----------|------|
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |

| no. | issue                        | date          |
|-----|------------------------------|---------------|
| 1   | Issued for Permit and Tender | Apr. 03, 2024 |
| 2   | Issued for Construction      | May 10, 2024  |
|     |                              |               |
|     |                              |               |
|     |                              |               |
|     |                              |               |
|     |                              |               |

project  
WRDSB TAIT STREET PUBLIC SCHOOL CEILINGS RENOVATIONS

WATERLOO REGION DISTRICT SCHOOL BOARD  
184 TAIT ST., CAMBRIDGE, ON N1S 3G3

drawing  
PART GROUND FLOOR PLAN

drawing scale  
1:50

ward99 project number  
23013 - WRDSB TAIT ST CEILINGS


VX Engineering project number  
2405 - TAIT CEILINGS

ward99 architects inc.  
drawing no.

**Wa RD<sub>99</sub>**

**S1**

ward99 architects inc.  
7500 Hwy 27 unit 27B  
vaughan, ontario L4H 0J2  
416 613 5880 www.ward99architects.com

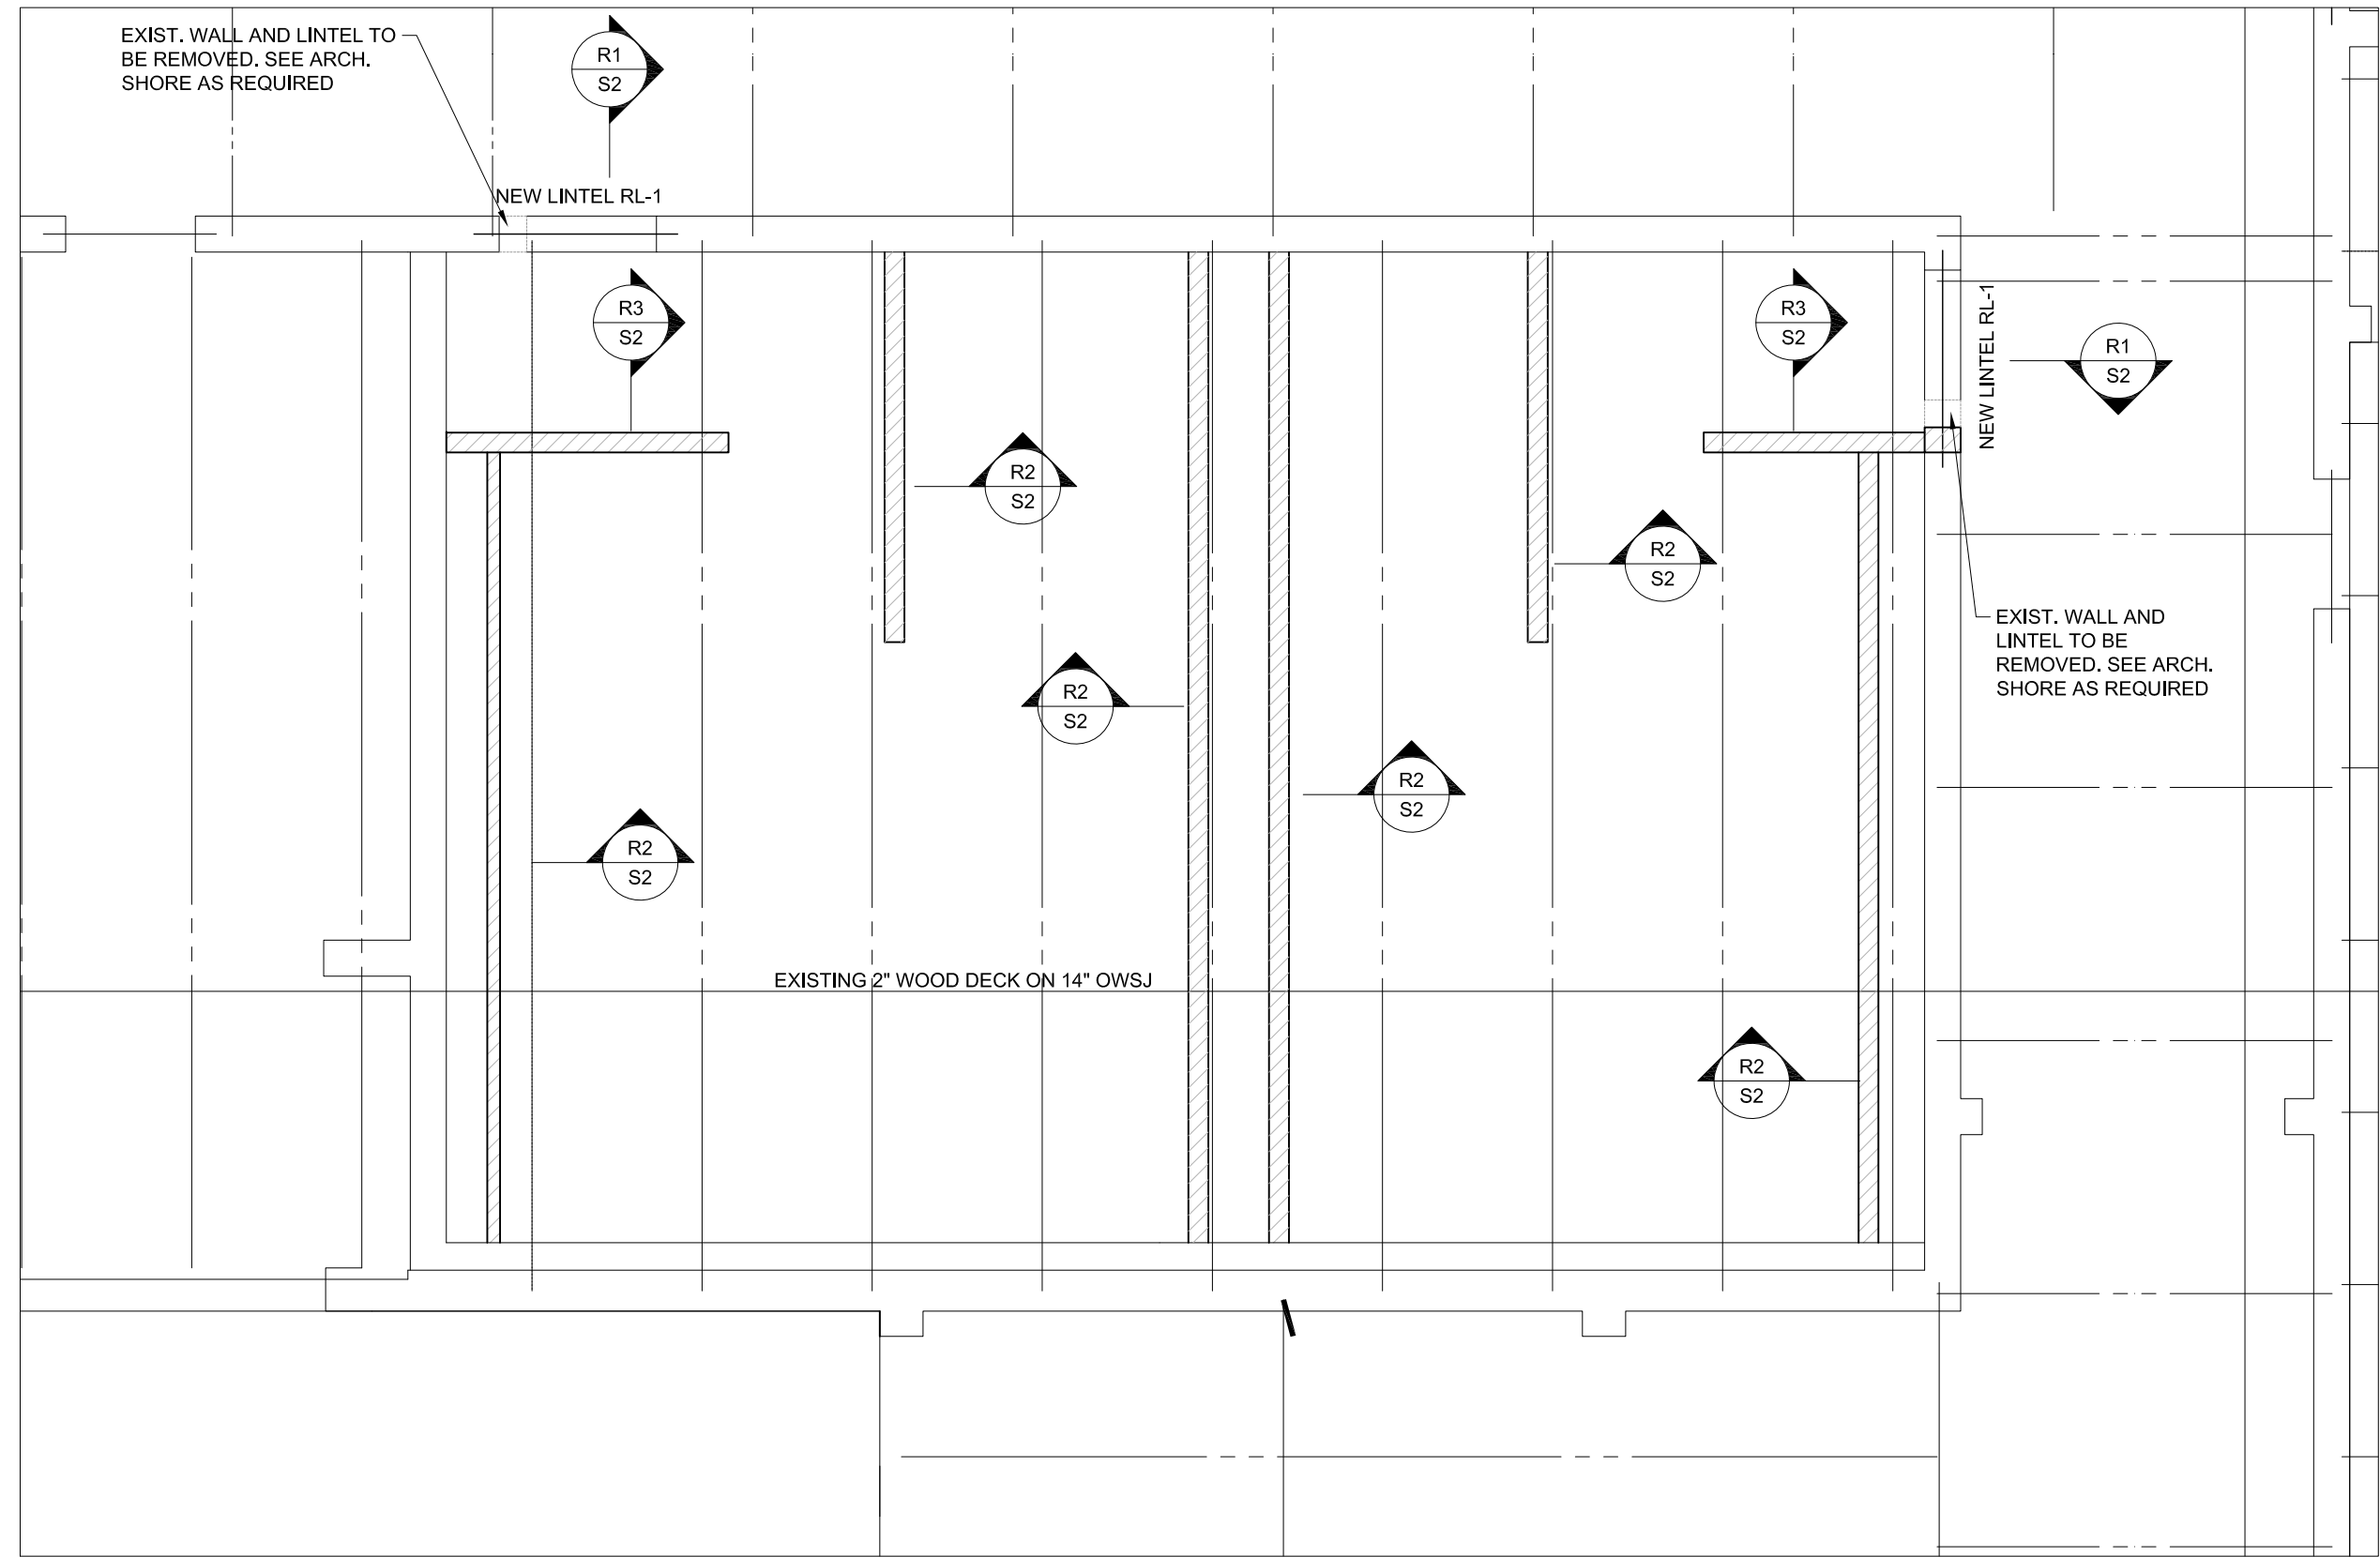

**PART ROOF FRAMING PLAN** SCALE 1:50

- FOR ROOF SLOPES AND ELEVATIONS SEE ARCHITECTURAL DRAWINGS.
- ROOF STRUCTURE IS EXISTING UNLESS NOTED OTHERWISE. EXISTING FRAMING DATA ARE TAKEN FROM THE ORIGINAL DRAWINGS DESIGNED BY JOHN F. ROSS ARCHITECT ON YEAR 1998. REPORT TO CONSULTANTS DISCREPANCIES AND NECESSARY ADJUSTMENTS DUE TO ACTUAL CONDITIONS BEFORE PROCEEDING WITH WORK.
- SPECIFIED SNOW LOAD IS 1.68kN/m<sup>2</sup>. ADD DRIFT SNOW AS SHOWN. MULTIPLY SNOW LOADS BY IMPORTANCE FACTOR - SEE IMPORTANCE FACTOR TABLE.
- SEE ALSO TYPICAL DETAILS AND GENERAL NOTES ON THESE DRAWINGS.
- UNLESS NOTED OTHERWISE PROVIDE 170 X 12 X 200 BEARING PLATES EACH END OF ALL STEEL BEAMS. ALL BEARING PLATES SHALL BE WITH 2-190 WELDED ANCHORS X 250 LG. WELD BEAM TO BEARING PLATES TYPICAL.
- REFER TO OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS FOR ROOF MOUNTED OR SUSPENDED UNITS. SHOW THE UNITS ON THE STEEL FABRICATORS SHOP DRAWINGS AND OBTAIN ARCHITECTS, MECHANICAL AND OR ELECTRICAL ENGINEERS APPROVAL OF WEIGHTS AND LOCATIONS BEFORE FABRICATION IS STARTED.
- UNLESS NOTED OTHERWISE FOR LINTELS OVER MECHANICAL WALL OPENINGS REFER TO "LINTELS FOR DUCTS AND SERVICES" ON TYPICAL DETAIL SHEET. FOR ALL NEW LINTELS IN EXISTING WALLS CONFIRM WALL THICKNESS BEFORE LINTELS ARE FABRICATED. REFER TO ARCHITECTURAL AND MECHANICAL DRAWINGS FOR EXACT LOCATIONS.
- BLOCK VOIDS WITH REINFORCING OR SHOWN AS "FILLED SOLID" SHALL BE FILLED WITH 20MPa CONCRETE WITH PEA GRAVEL OR 20MPa COARSE GROUT.
- WIND LOAD PARAMETERS, AS PER OBC 2012 AND CHANGES 2020, PART 4, 1/2 WIND PRESSURE 0.36kPa, 1/10 WIND PRESSURE 0.28kPa.
- SEISMIC LOAD PARAMETERS, AS PER OBC 2012 AND CHANGES 2020, PART 4, EQUIVALENT STATIC ANALYSIS, SHEAR WALL SYSTEM. Sa(0.2)=0.141, Sa(0.5)=0.084, Sa(1.0)=0.047, Sa(2.0)=0.024, Sa(5.0)=0.0058, Sa(10.0)=0.0024, Fa=1.24, Fv=1.55, Ie=1.3, R<sub>d</sub>=1.5, R<sub>o</sub>=1.5. SOIL CLASS D (ASSUMED), IeFaSa(0.2)=0.227-0.35
- REFER TO "IMPORTANCE FACTOR" TABLE.
- SHORE AS REQUIRED.

IMPORTANCE FACTOR CATEGORY 'HIGH'


|            | ULS  | SLS  |
|------------|------|------|
| SNOW       | 1.15 | 0.9  |
| WIND       | 1.15 | 0.75 |
| EARTHQUAKE | 1.3  | 1.0  |

**ROOF NEW LINTEL SCHEDULE**


| MARK     | MATERIAL                     | TYPE        | REMARKS   |
|----------|------------------------------|-------------|---|
| NEW RL-1 | W200 X 27 + 240 X 8 PL. BOT. | EXIST. WALL | STOP BOT. PL. SHORT OF OPENING & PROVIDE TYPICAL BEARING PLATE E.E. EXTEND 200mm EACH END BUILD TIGHT TO U/S OF EXIST. WALL |

- LINTEL NOTES:
- GENERAL CONTRACTOR SHALL PROVIDE 38 X 5 X 150 MASONRY TIES WELDED TO BM AT 600 c/c TYP. FOR ALL BEAM LINTELS AND BEAMS IN MASONRY
  - PROVIDE 1-19# A. BOLTS X 200 LG GROUTED INTO BLOCK VOIDS OF PIERS BETWEEN OPENINGS. WHERE APPLICABLE.
  - UNLESS NOTED OTHERWISE BOT. PLATE OF BEAM LINTELS SHALL STOP SHORT OF OPENINGS AND BEAM BEARING PLATE SHALL BE PROVIDED.
  - FIRST BLOCK COURSE ABOVE STEEL LINTEL SHALL BE FILLED SOLID WITH 20MPa CONCRETE. TYP.


**1** PART ROOF FRAMING PLAN  
**S2** 1:50

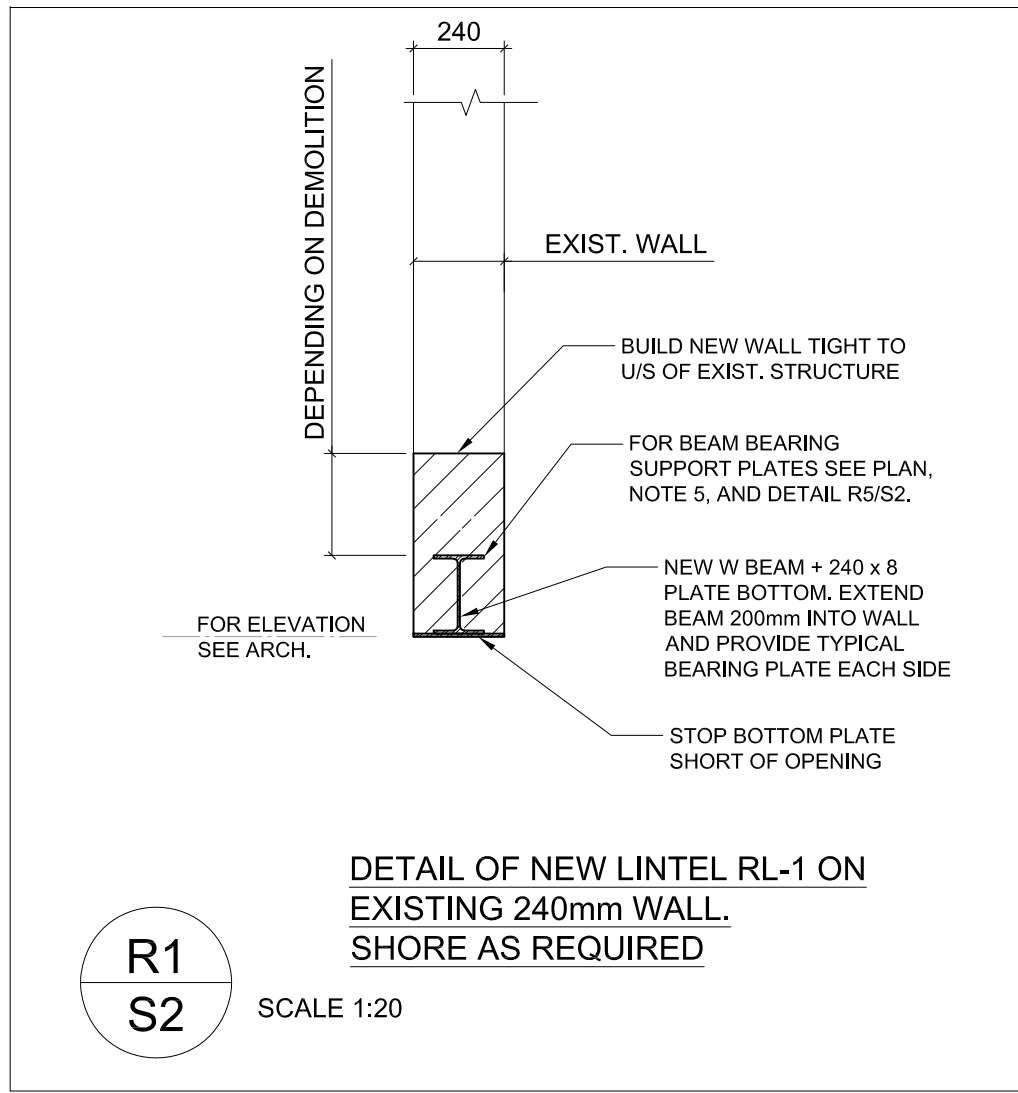


**R1**  
**S2** SCALE 1:20

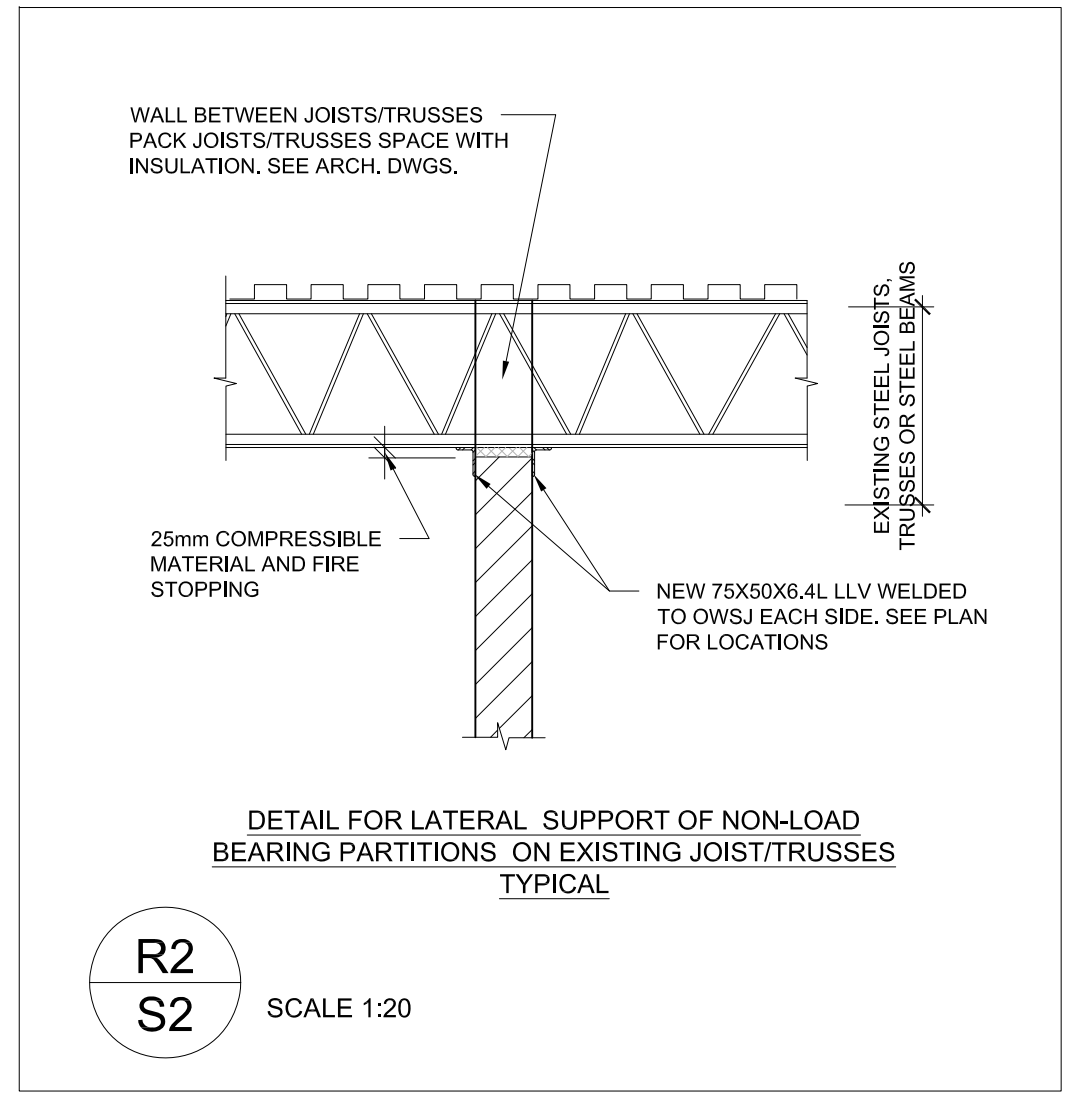


**R2**  
**S2** SCALE 1:20

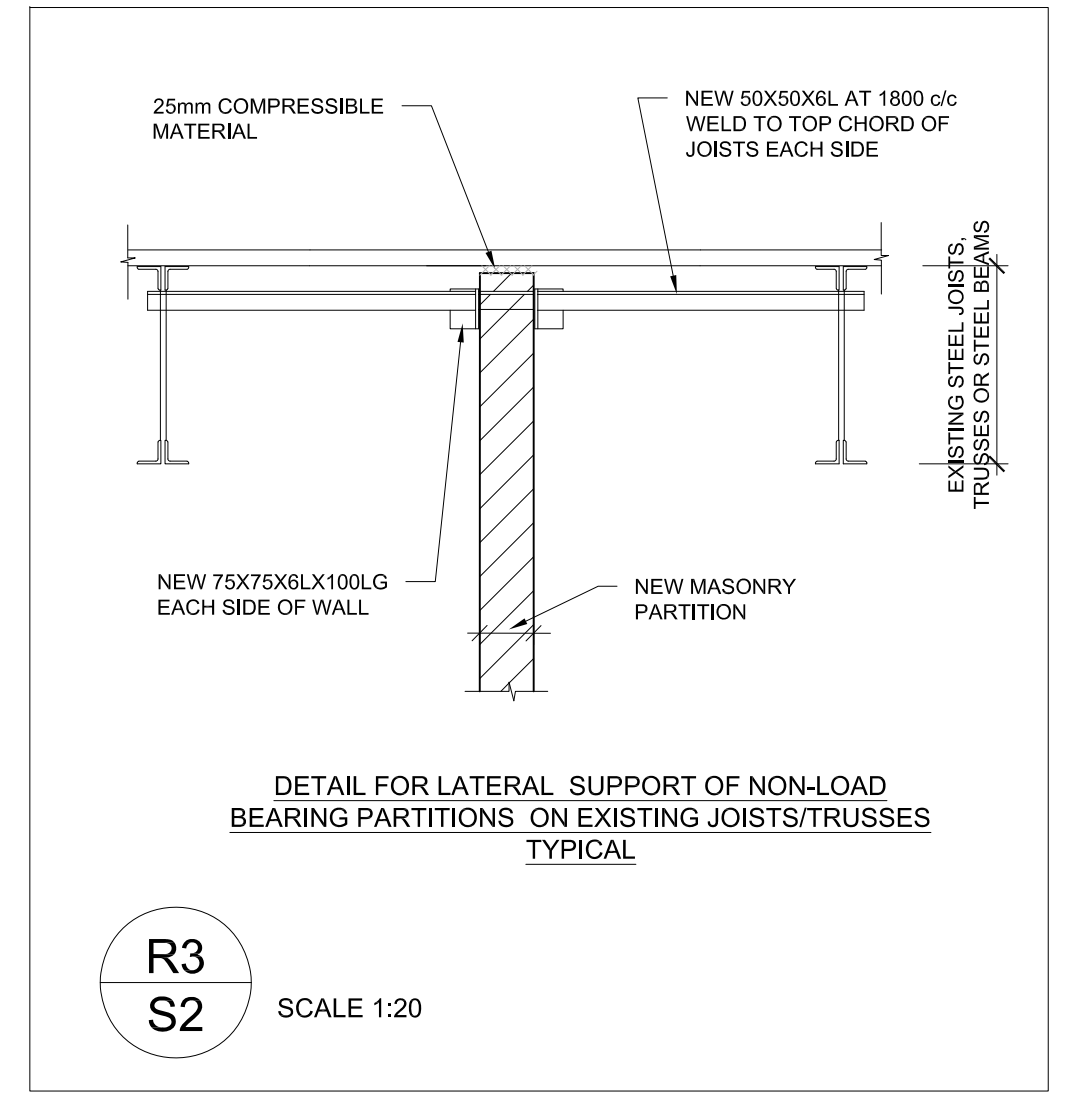

**R3**  
**S2** SCALE 1:20

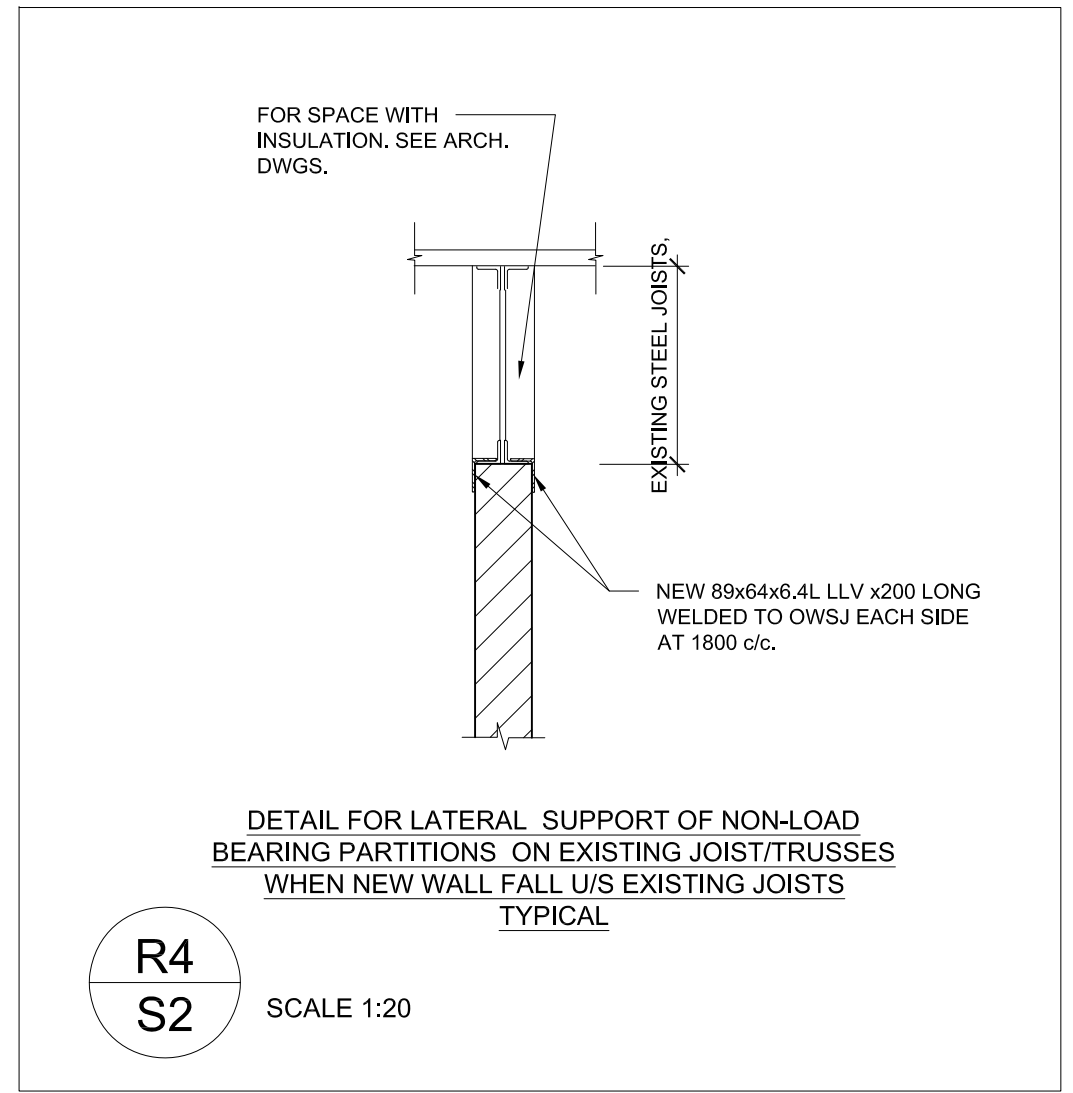

**R4**  
**S2** SCALE 1:20

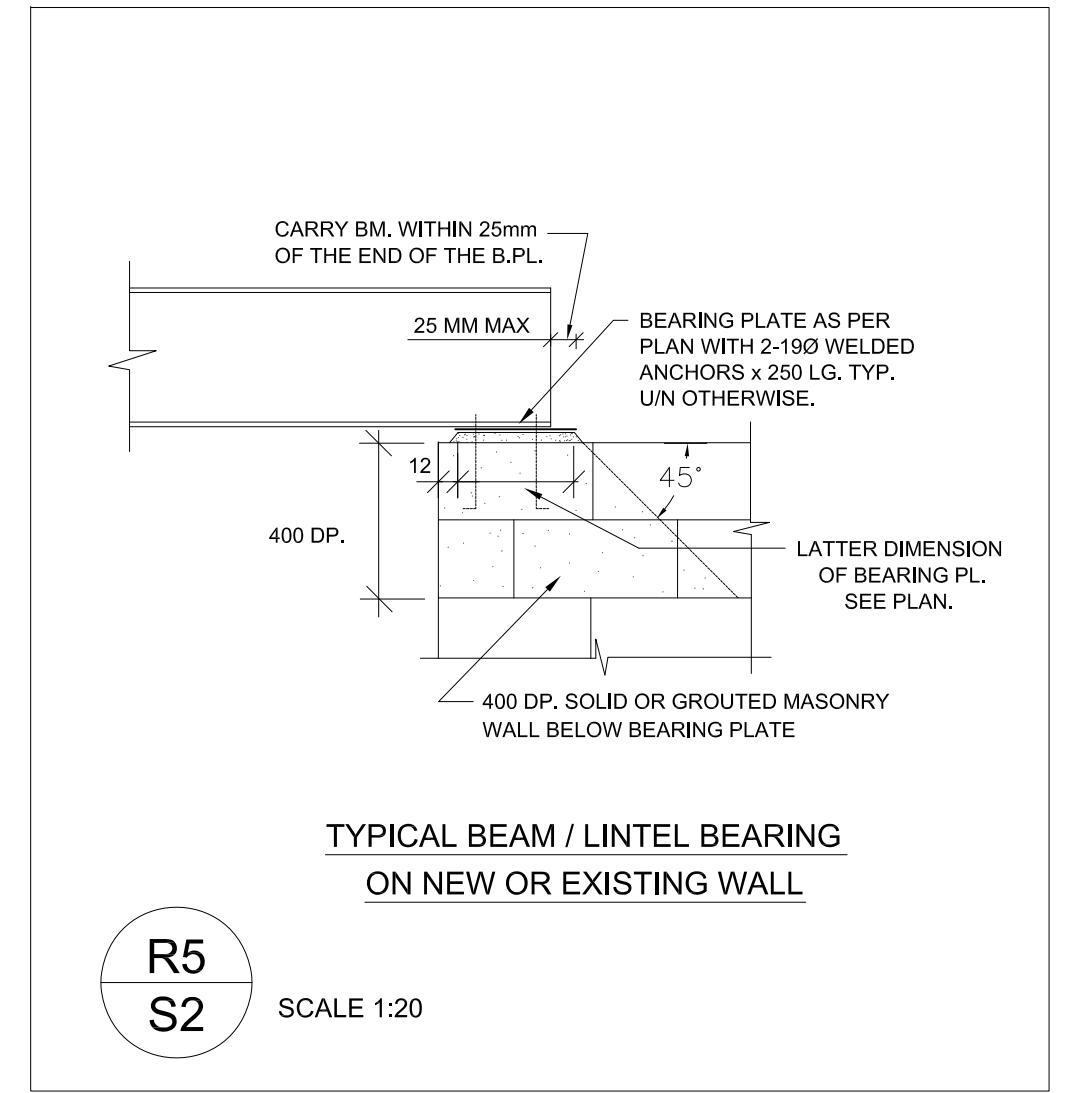


**R5**  
**S2** SCALE 1:20



VX ENGINEERING inc.  
2500 - 135Marlee Avenue  
Toronto Ontario M6B 4C6  
416 670 9422 www.vxengineering.com

NOTE: THIS DRAWING IS NOT TO BE SCALED. THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF ALL SITE DIMENSIONS AND FOR NOTIFYING THE ARCHITECT OF ANY SITE CONDITIONS AND SITE MEASUREMENTS THAT ARE NOT CONSISTENT WITH THE DRAWINGS.

| no. | revision | date |
|-----|----------|------|
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |



| no. | issue                        | date          |
|-----|------------------------------|---------------|
| 1   | Issued for Permit and Tender | Apr. 03, 2024 |
| 2   | Issued for Construction      | May 10, 2024  |

project  
WRDSB TAIT STREET PUBLIC SCHOOL CEILING RENOVATIONS

WATERLOO REGION DISTRICT SCHOOL BOARD  
184 TAIT ST., CAMBRIDGE, ON N1S 3G3

drawing  
**PART ROOF FRAMING PLAN**

drawing scale  
1:50

ward99 project number  
23013 - WRDSB TAIT ST CEILINGS

VX Engineering project number  
2405 - TAIT CEILINGS

ward99 architects inc.  
drawing no.  
**S2**

ward99 architects inc.  
7500 Hwy 27 unit 27B  
vaughan, ontario L4H 0J2  
416 613 5890 www.ward99architects.com

**ONE WAY SLAB DETAILS**

**CONSTRUCTION JOINT IN FRAMED SLABS**

- JOINT SHALL BE LOCATED SO AS NOT TO IMPAIR THE STRENGTH OF THE STRUCTURE.
- REIN. STEEL AND CONC. SURFACE SHALL BE CLEANED AND TREATED WITH BONDING AGENT.

**TEMPERATURE REINFORCING**  $F_y = 400\text{MPa}$

| SLAB(mm) THICKNESS | REIN. (As = 0.002 Ag) | SLAB(mm) THICKNESS | REIN. (As = 0.002 Ag) |
|--------------------|-----------------------|--------------------|-----------------------|
| 65                 | 10M AT 500            | 200                | 15M AT 500            |
| 100                | 10M AT 500            | 215                | 15M AT 460            |
| 115                | 10M AT 450            | 225                | 15M AT 440            |
| 125                | 10M AT 410            | 240                | 15M AT 410            |
| 135                | 10M AT 380            | 250                | 15M AT 400            |
| 150                | 10M AT 340            | 265                | 15M AT 380            |
| 165                | 10M AT 310            | 275                | 15M AT 360            |
| 175                | 10M AT 290            | 290                | 15M AT 340            |
| 190                | 10M AT 270            | 300                | 15M AT 330            |

**TEMPERATURE REINFORCING**  $F_y = 400\text{MPa}$

| SLAB(mm) THICKNESS | REIN. (As = 0.002 Ag) | SLAB(mm) THICKNESS | REIN. (As = 0.002 Ag) |
|--------------------|-----------------------|--------------------|-----------------------|
| 65                 | 10M AT 500            | 200                | 15M AT 500            |
| 100                | 10M AT 500            | 215                | 15M AT 460            |
| 115                | 10M AT 450            | 225                | 15M AT 440            |
| 125                | 10M AT 410            | 240                | 15M AT 410            |
| 135                | 10M AT 380            | 250                | 15M AT 400            |
| 150                | 10M AT 340            | 265                | 15M AT 380            |
| 165                | 10M AT 310            | 275                | 15M AT 360            |
| 175                | 10M AT 290            | 290                | 15M AT 340            |
| 190                | 10M AT 270            | 300                | 15M AT 330            |

**REINFORCED WALL FTG.** **UNREINFORCED WALL FTG.** **TYPICAL THICKENING OF SLAB ON GRADE UNDER PARTITIONS**

**VERTICAL CONSTRUCTION JOINT IN WALLS**

- JOINT SHALL BE LOCATED SO AS NOT TO IMPAIR THE STRENGTH OF THE STRUCTURE.
- REIN. STEEL AND CONC. SURFACE SHALL BE CLEANED AND TREATED WITH BONDING AGENT.

**DOWELLING OF INTERSECTING WALL**

**TYPICAL WALL SECTION** **STEPPING OF WALL FOOTING** **DETAIL OF CONCRETE FILL AROUND PIPE BELOW CONT. WALL FOOTING**

**FOUNDATION & WALL DETAILS**

**COLUMN BASE PL. LEVELING PL. U/N OTHERWISE**

**SPREAD FOOTING UNDER OTHER THAN Poured CONCRETE COLS.** **SPREAD FOOTING UNDER CONCRETE COLUMNS**

**REINFORCED WALL FTG.** **UNREINFORCED WALL FTG.** **TYPICAL THICKENING OF SLAB ON GRADE UNDER PARTITIONS**

**VERTICAL CONSTRUCTION JOINT IN WALLS**

- JOINT SHALL BE LOCATED SO AS NOT TO IMPAIR THE STRENGTH OF THE STRUCTURE.
- REIN. STEEL AND CONC. SURFACE SHALL BE CLEANED AND TREATED WITH BONDING AGENT.

**DOWELLING OF INTERSECTING WALL**

**TYPICAL WALL SECTION** **STEPPING OF WALL FOOTING** **DETAIL OF CONCRETE FILL AROUND PIPE BELOW CONT. WALL FOOTING**

**STRUCTURAL STEEL AND OPEN WEB STEEL JOIST DETAILS**

**O.W.S.J. BEARING ON STEEL** **O.W.S.J. BEARING ON MASONRY** **TYPICAL FOR ALL COLUMNS**

**TYPICAL BEAM BEARING** **BEAM BEARING ON CONCRETE PAD**

**NOTES:**

- O.W.S.J. BEARING, ANCHORAGE AND BRIDGING REQUIREMENTS SHALL BE IN ACCORDANCE WITH CAN - S16.1
- CONTRACTOR TO TAKE ALL NECESSARY PRECAUTIONS WHEN POURING CONC. SLABS OVER O.W.S.J. TO AVOID LATERAL DEFLECTION AND TWISTING OF JOISTS. THIS APPLIES PARTICULAR TO FREE ENDS OF JOISTS RUNS.
- JOISTS BEARING PLATES SHALL BE DESIGNED BY JOIST DESIGNER AND 50mm WIDER THAN JOIST SHOE.
- PROVIDE CEILING EXTENSIONS WHERE REQUIRED.
- JOISTS MARKED T.J. ON PLANS DENOTES THE JOISTS.
- JOIST WORKING POINT SHALL BE LOCATED IN MIDDLE 1/3 OF BEAM FLANGE OR SUPPORTING WALL.
- TYP. SLAB U/N OTHERWISE - 60mm CONC. SLAB OVER STEEL DECK. SLAB REIN. 152 x 152 MW18/MW18.7 W/F PLACING 40mm FROM TOP SURFACE.

**LINTEL DETAILS**

**REINFORCED CONCRETE MASONRY LINTEL DENOTED RCML.** **TYPICAL DETAIL**

**NOTES FOR RCML:**

- FOR LINTELS IN PARTITIONS AND BEARING WALLS, UP TO 1200mm CLEAR SPAN, PROVIDE 1-10M BAR TOP AND BOTTOM FOR EACH 100mm OF WALL THICKNESS OR PORTION THEREOF.
- FOR CLEAR SPANS FROM 1200mm TO 1800mm PROVIDE 1-15M HOOKED TOP AND BOTTOM AS CALLED FOR NOTE NO.1.
- LINTEL BEAM UNITS SHALL BE FILLED WITH CONCRETE HAVING AN ULTIMATE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS. LENGTH OF BEARING SHALL BE 200mm MIN.
- WHERE LINTELS FRAME INTO REINFORCED CONCRETE COLUMNS, REINFORCED CONCRETE WALLS OR STEEL COLUMNS, PROVIDE 90 X 90 X 10 SHELF ANGLE FOR ANCHORAGE, USE WELDING OR 2-19# INSERT ANCHORS, EXCEPT AS OTHERWISE SPECIFIED ON DRAWINGS.

| CLEAR SPAN       | 140mm WALL |                      | 190mm WALL |                   | 240mm WALL |                    | 290mm WALL |                       |
|------------------|------------|----------------------|------------|-------------------|------------|--------------------|------------|-----------------------|
|                  | TYPE       | MATERIAL             | TYPE       | MATERIAL          | TYPE       | MATERIAL           | TYPE       | MATERIAL              |
| UP TO 1200mm     | JL         | 2L's 90 x 65 x 8 LLV | JL         | 2L's 90 x 90 x 8  | JL         | 2L's 100 x 100 x 8 | JL         | 3L's 90 x 90 x 8      |
| 1200mm TO 2000mm | JL         | 2L's 90 x 65 x 8 LLV | JL         | 2L's 150 x 90 x 8 | JL         | 2L's 150 x 100 x 8 | JL         | 3L's 150 x 90 x 8 LLV |

**NOTES FOR STEEL LINTELS:**

- DOUBLE ANGLES SHALL BE PLACED BACK TO BACK AND BOLTED TOGETHER WITH BOLTS AT 600c/c OR EQUIVALENT STITCHWELD TOP AND BOTTOM 16# MIN.
- MINIMUM BEARING OF LINTELS SHALL BE 150mm SEE PLAN ABOVE
- FOR WALLS THICKER THAN 290mm ADD 1 ANGLE OF SIZE SPECIFIED ABOVE FOR EVERY 100 OF MASONRY OR PORTION THEREOF.
- SEE NOTE NO.4 ABOVE
- FOR LINTELS IN NON-LOAD BEARING 140 WALLS OVER 2000mm, PROVIDE W200 X 27 BEAM.
- PROVIDE SINGLE 90 X 90 X 8L FOR OPENINGS IN 90mm BLOCK ENCLOSURES FOR SPAN UP TO 1200mm. FOR LOCATIONS SEE ARCHITECTURAL AND MECHANICAL DRAWINGS.

**MASONRY DETAILS**

**EXTERIOR WALL AT GROUND FLOOR LEVEL** **INTERIOR WALL AT GROUND FLOOR LEVEL**

**ROOF SECTION** **PRECAST FLOOR SLAB BEARING**

**MASONRY CONTROL JOINT**

**MASONRY CONTROL JOINT**

**ELEVATION (TYPICAL WALL/STEEL COL. LOCATION)** **TYPICAL BEAM BEARING**

**UNDERPINNING**

**TYPICAL WALL SECTION** **STEPPING OF WALL FOOTING** **DETAIL OF CONCRETE FILL AROUND PIPE BELOW CONT. WALL FOOTING**

**LINTELS FOR DUCTS AND SERVICES**

**LINTELS FOR DUCT OPENINGS THRU WALLS SUPPORTING P.C. SLABS**

**LINTELS FOR DUCT OPENINGS THRU WALLS SUPPORTING O.W.S.J.**

| CLEAR SPAN   | WALL THICKNESS                                |   |   |
|--------------|---|---|---|
|              | 190 WALL                                      | 240 WALL                                      | 290 WALL                                      |
| UP TO 700 mm | 2 L's 90 x 90 x 8                             | 1 L's 125 x 90 x 8 LLV + 1 L 100 x 100 x 8    | 1 L's 125 x 90 x 8 LLV                        |
| UP TO 950 mm | 2 L's 125 x 90 x 8 LLV                        | 2 L's 150x100x8 LLV                           | 3 L's 125x90x8 LLV                            |
| UP TO 2400   | W150 X 22 OR W150X22 + 20X8 PL. BOT. FOR MAS. | W150 X 22 OR W150X22 + 20X8 PL. BOT. FOR MAS. | W150 X 22 OR W150X22 + 27X8 PL. BOT. FOR MAS. |

**NOTES:**

- PROVIDE MINIMUM 400mm SOLID MASONRY BETWEEN MECHANICAL OPENINGS. TYPICAL.
- UNLESS NOTED OTHERWISE, FOR OPENINGS IN EXTERIOR WALLS PROVIDE LINTEL AS NOTED ABOVE FOR BACK UP WALL + STEEL ANGLE FOR VENEER. PROVIDE 90 X 90 X 8L FOR SPAN UP TO 1200mm OR 150 X 90 X 8L LLV FOR SPAN UP TO 2000mm.

**GENERAL NOTES**

CHECK ALL DIMENSIONS SHOWN ON THE STRUCTURAL DRAWINGS AND REPORT DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.

FOR LOCATION OF Sumps, PITS, BASES AND DEPRESSIONS REFER TO ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS.

DO NOT EXCEED THE DESIGN LIVE LOADS SHOWN DURING CONSTRUCTION.

THIS STRUCTURE HAS BEEN DESIGNED TO COMPLY WITH O.B.C. 2012.

THE GENERAL CONTRACTOR SHALL EXAMINE EXISTING SITE CONDITIONS AND REPORT ANY INCONSISTENCIES TO THE ARCHITECT BEFORE STARTING ANY WORK.

REFER TO ARCHITECTURAL DRAWINGS FOR STEPPING OF WALL FOOTINGS.

**FOUNDATION NOTES:**

FOOTING EXCAVATIONS SHALL BE INSPECTED BY A SOILS ENGINEER BEFORE CONCRETE IS PLACED.

FOOTINGS EXPOSED TO FREEZING SHALL BE PLACED AT LEAST 1200mm BELOW FINISHED GRADE.

PROTECT FOOTINGS EXPOSED TO FROST ACTION DURING CONSTRUCTION BY 1200mm OF SOIL OR ITS EQUIVALENT.

THE LINE OF SLOPE BETWEEN ADJACENT FOOTINGS, EXCAVATIONS OR ALONG STEPPED FOOTINGS SHALL NOT EXCEED A RISE OF 7 IN A RUN OF 10. MAXIMUM STEP 600mm.

WHERE A FOUNDATION WALL RETAINS SOIL ON EACH FACE BACKFILL ON BOTH SIDES SIMULTANEOUSLY.

PROVIDE FOOTINGS FOR PARTITIONS THICKER THAN 150mm.

REFER TO THE SOIL REPORT FOR SOIL CONDITIONS AND BEARING PRESSURES.

**STRUCTURAL STEEL NOTES:**

CENTRE BEARING PLATES UNDER BEAMS OR AS NOTED. BEARING PLATE DIMENSION GIVEN LAST INDICATES SIDE PARALLEL TO BEAM WEB.

STRUCTURAL STEEL SHALL BE GRADE G40.21M 350W HOLLOW STRUCTURAL SECTIONS WHICH SHALL BE G40.21M 350W CLASS 'C'.

**CONCRETE NOTES:**

THE ULTIMATE 28 DAY STRENGTH OF CONCRETE SHALL BE 25MPa. REINFORCING STEEL SHALL BE DEFORMED BARS OF 400MPa YIELD STRENGTH.

**MASONRY NOTES:**

PROVIDE MINIMUM 200mm OF BEARING FOR STEEL OR CONCRETE BEAMS SUPPORTED ON MASONRY. REFER TO DRAWINGS FOR SIZES OF BEARING PLATES. BEARING SHALL BE OF SOLID BLOCK OR BLOCK FILLED SOLID WITH 20MPa CONCRETE 400mm DEEP AND PROJECTING 200mm EACH SIDE OF BEAM BEARING PLATE, BASE PLATE OR CONCRETE PAD. REFER ALSO TO TYPICAL DETAIL SHEET M4.

PROVIDE 200mm DEPTH OF SOLID MASONRY UNDER STEEL JOISTS BEARING ON MASONRY.

BUILD MASONRY TIGHT INTO WEBS OF BEAMS AT THEIR BEARINGS.

PROVIDE ALL TEMPORARY BRACING REQUIRED TO HOLD ALL WALLS PLUMB AND TRUE TO LINE DURING CONSTRUCTION UNTIL THE BUILDING IS COMPLETED.

ALL LOAD BEARING MASONRY WALLS SHALL BE "ENGINEERED MASONRY" IN COMPLIANCE WITH CAN/CSA S304.1.

ALL BLOCK WALLS SHALL BE CONSTRUCTED FROM CONCRETE BLOCK UNITS IN COMPLIANCE WITH CAN/CSA-A165 SERIES. MINIMUM COMPRESSIVE STRENGTH 15MPa UNLESS NOTED OTHERWISE ON DRAWINGS.

ALL BLOCK VOIDS WITH REINFORCING BARS SHALL BE FILLED SOLID WITH 20MPa OR COURSE GROUT.

PROVIDE MINIMUM TWO SOLID OR FILLED SOLID WITH 20MPa CONCRETE, BLOCK COURSES FOR ALL PRECAST SLABS SUPPORTED ON MASONRY.

ALL MASONRY PARTITIONS SHALL BE CONSTRUCTED ON TOP OF CONCRETE TOPPING OF PRECAST FLOOR SLABS.

**PRECAST CONCRETE SLABS:**

PRECAST CONCRETE SLABS SHALL BE DESIGNED IN COMPLIANCE WITH ALL APPLICABLE CODES AND SHOP DRAWINGS SHALL BE STAMPED BY A PROFESSIONAL ENGINEER LICENSED IN ONTARIO.

THE PRECAST SLAB SUPPLIER SHALL REVIEW THE TENDER DOCUMENTS AND CARRY IN HIS TENDER COSTS FOR ANY ADDITIONAL MATERIAL REQUIRED TO ACCOMMODATE PRECAST BEARING BUT NOT INDICATED ON THE STRUCTURAL DRAWINGS.

**VX ENGINEERING INC.**  
STRUCTURAL ENGINEERS

VX ENGINEERING inc.  
2500 - 135Marlee Avenue  
Toronto, Ontario M6B 4C6  
416 670 9422 www.vxengineering.com

**NOTE: THIS DRAWING IS NOT TO BE SCALED. THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF ALL SITE DIMENSIONS AND FOR NOTIFYING THE ARCHITECT OF ANY SITE CONDITIONS AND SITE MEASUREMENTS THAT ARE NOT CONSISTENT WITH THE DRAWINGS.**

| no. | revision | date |
|-----|----------|------|
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |
|     |          |      |

**PROJECT NORTH**

| no. | issue                        | date          |
|-----|------------------------------|---------------|
| 1   | Issued for Permit and Tender | Apr. 03, 2024 |
| 2   | Issued for Construction      | May 10, 2024  |

project: **WRDSB TAIT STREET PUBLIC SCHOOL CEILINGS RENOVATIONS**

WATERLOO REGION DISTRICT SCHOOL BOARD  
184 TAIT ST., CAMBRIDGE, ON N3S 3G3

**GENERAL NOTES**

Drawing scale: **NTS**

ward99 project number: 23013 - WRDSB TAIT ST CEILINGS  
VX Engineering project number: 2405 - TAIT CEILINGS

ward99 architects inc. drawing no. **S3**

ward99 architects inc.  
7500 Hwy 27 unit 27B  
vaughan, ontario L4H 0J2  
416 613 5880 www.ward99architects.com